

\*\*\*\*\*DISCLAIMER\*\*\*\*\*

Schematics are provided for illustration purposes only. GHIL must confirm applicability of these details to a specific project in writing prior to implementation.



Handrail 30 - 43 mm diameter  
min. 50 mm clear of wall,  
60 mm if wall surface rough or  
abrasive (max. encroachment into  
required exit stair width 100 mm.  
Stairway width greater than 1100 mm  
shall have handrails on both sides.


Non-slip stair surface with  
nosings having colour contrast  
or distinctive pattern at leading  
edge, readily apparent from  
both directions of travel.

Closed riser  
required.  
Maximum  
rakeback  
38 mm

Radius or bevel  
nose 6 - 10 mm  
measured horizontally  
(may be reduced to  
3 mm if resilient material  
used at leading edge)

Tactile Warning Surface  
where required

- Slip resistant
- Max. 3 mm above  
or below floor
- Different in texture and  
colour from floor
- Full width of stair

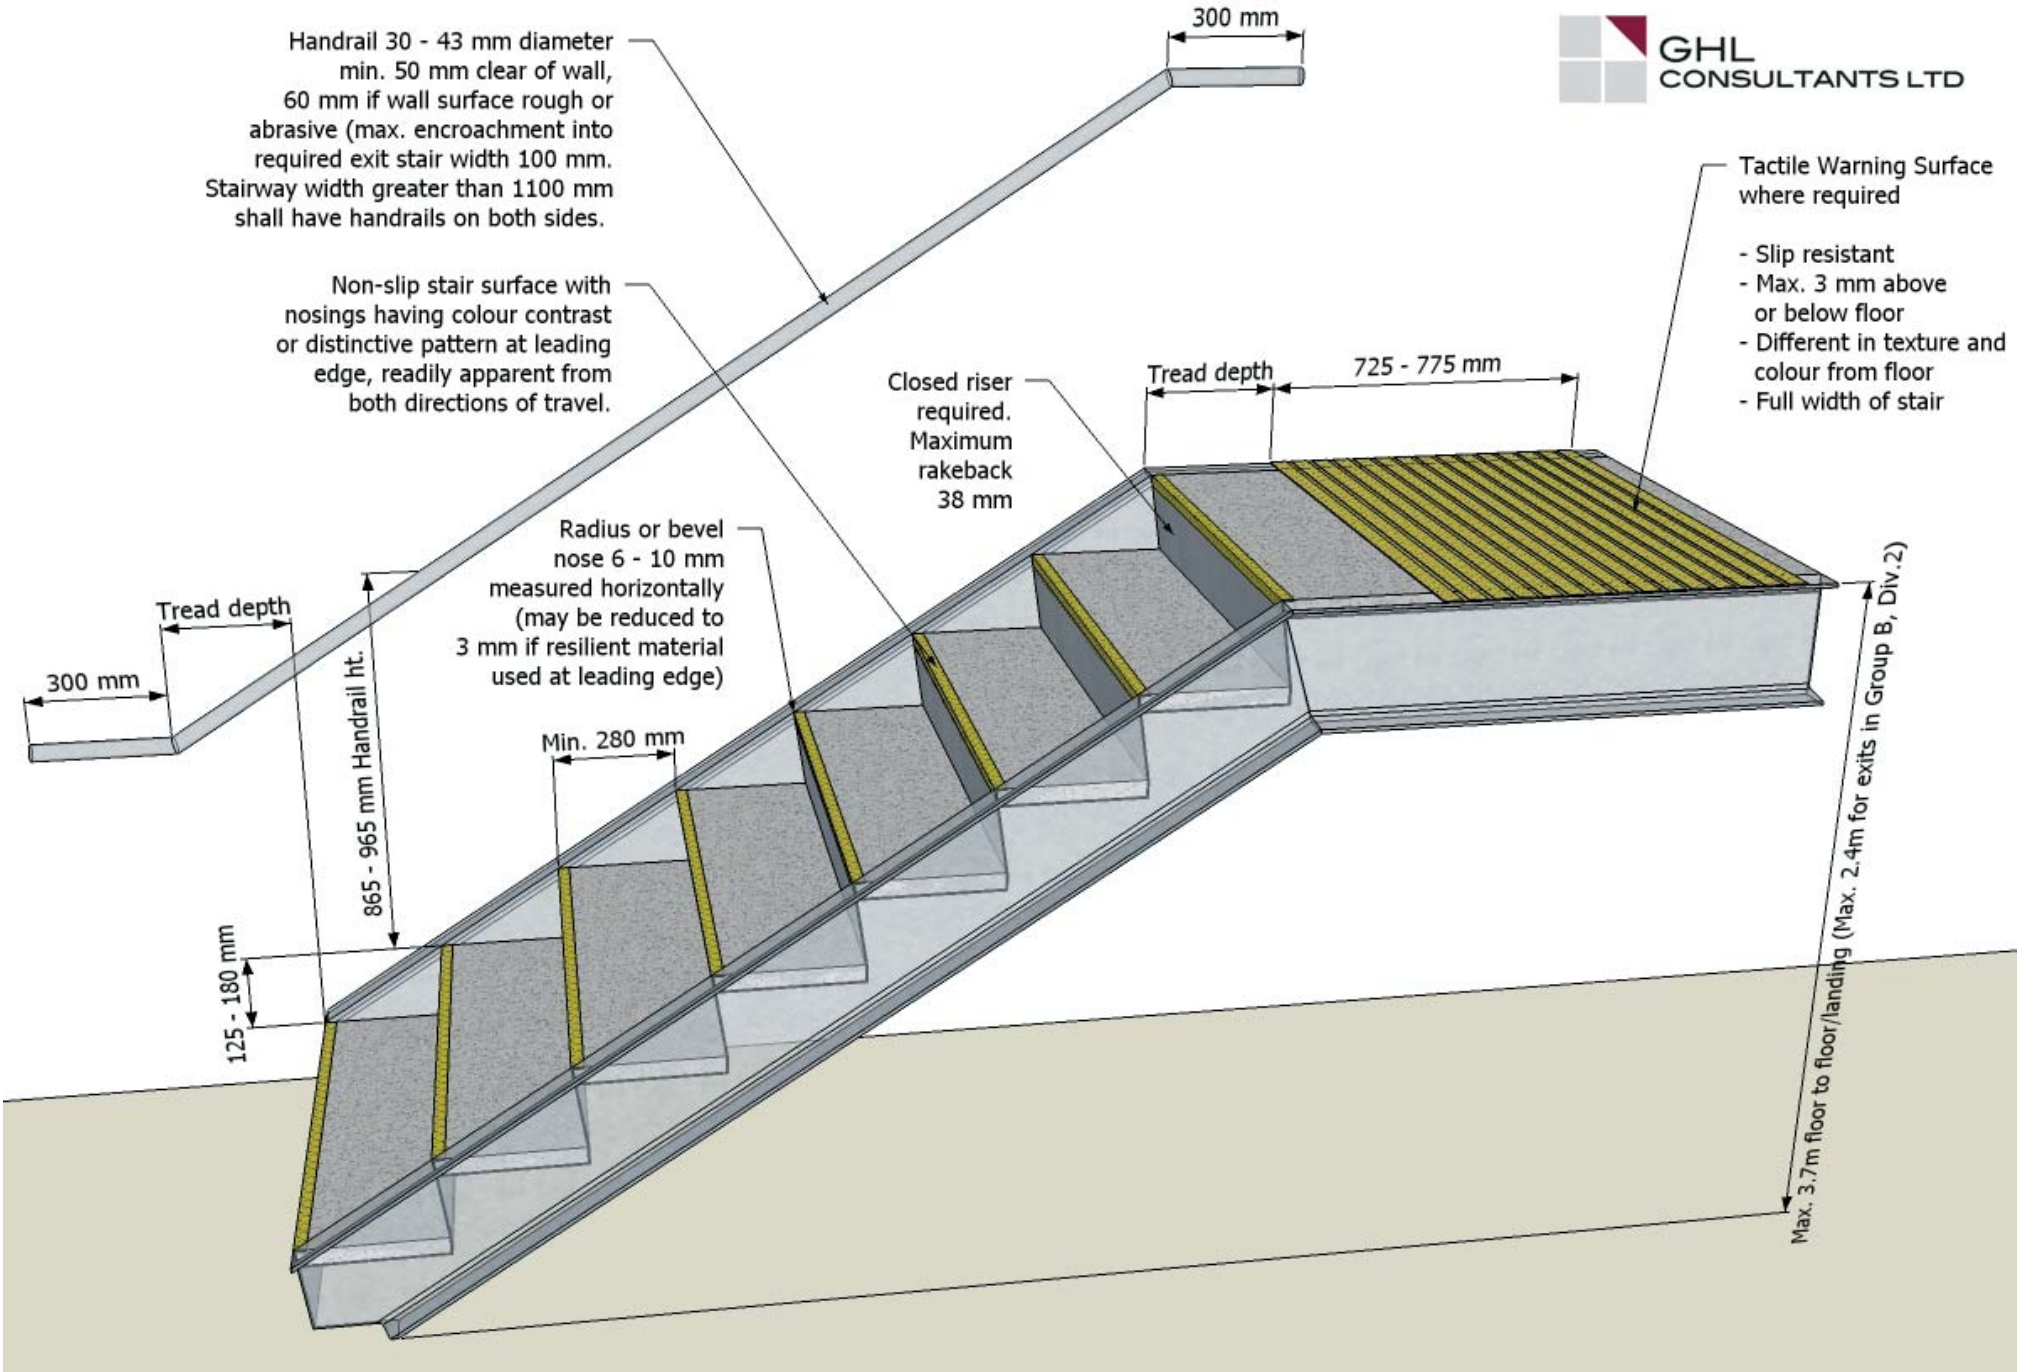

Max. 3.7m floor to floor/landing (Max. 2.4m for exits in Group B, Div.2)

